

**AISSMS GROUP  
OF COLLEGES -  
KENNEDY ROAD  
CAMPUS, PUNE**

**ENERGY AUDIT  
REPORT**

**AUDITED BY**

**Mr. UPENDRA DEUSKAR**

**BEE CERTIFIED ENERGY AUDITOR**


513/E, RUIKAR TRUST BUILDING , NEAR ST STAND,

DABHOLKAR CORNER, KOLHAPUR.

CELL-9422044172

E-mail- [upendraasso@gmail.com](mailto:upendraasso@gmail.com)


Date- 22<sup>nd</sup> Decemer, 2022



**Principal  
AISSMS College of Pharmacy  
Pune-1**

## Table of Contents


i.	Acknowledgement.....	5
ii.	Energy Audit Team.....	5
iii.	Instruments.....	5
iv.	Executive Summary.....	6
	Other energy saving measures & cost saving measures .....	6
1	Introduction.....	7
1.1	General Description of Facility.....	7
1.2	Objectives.....	7
1.3	Scope of Work.....	7
1.4	Energy Source and Breakup.....	8
1.5	Electricity Consumption.....	9
1.6	Water Consumption.....	11
1.7	Harmonics Study.....	11
1.7.1	Voltage Harmonics.....	12
1.7.2	Current Harmonics.....	16
1.7.3	Limits of Harmonics.....	20
2	Power Parameter Profiles.....	22
2.1	Power Parameter Profiles.....	22
3	Energy Conservation Measures.....	32
3.1	Energy conservation measures already undertaken by college.....	32
	Other energy saving measures & cost saving measures .....	32



*Upendra Deuskar*  
Principal  
AISSMS College of Pharmacy  
Pune-1

## List of Tables

Table 1 Bill Analysis – Last 12 months .....	9
Table 2 Average Water consumption .....	11
Table 3. Voltage Harmonics level at Engineering College.....	13
Table 4. Voltage Harmonics level at Management College .....	14
Table 5. Voltage Harmonics level at College of Pharmacy .....	14
Table 6. Voltage Harmonics level at Polytechnic College .....	15
Table 7. Current Harmonics Level – Engineering College .....	16
Table 8. Current Harmonics Level – Management College .....	17
Table 9. Current Harmonics Level – College of Pharmacy .....	18
Table 10. Current Harmonics Level – Polytechnic College .....	19
Table 11. Harmonics Distortion Limits: – IEEE – 519C:2014 .....	20
Table 12. Current distortion limits for systems rated 120 V to 69 kV – User's responsibility .....	20



*Upendra Deuskar*

**Principal**  
**AISSMS College of Pharmacy**  
**Pune-1**

## List of Tables

Table 1 Bill Analysis – Last 12 months .....	9
Table 2 Average Water consumption .....	11
Table 3. Voltage Harmonics level at Engineering College.....	13
Table 4. Voltage Harmonics level at Management College .....	14
Table 5. Voltage Harmonics level at College of Pharmacy .....	14
Table 6. Voltage Harmonics level at Polytechnic College .....	15
Table 7. Current Harmonics Level – Engineering College .....	16
Table 8. Current Harmonics Level – Management College .....	17
Table 9. Current Harmonics Level – College of Pharmacy .....	18
Table 10. Current Harmonics Level – Polytechnic College .....	19
Table 11. Harmonics Distortion Limits: – IEEE – 519C:2014 .....	20
Table 12. Current distortion limits for systems rated 120 V to 69 kV – User's responsibility .....	20



A handwritten signature in blue ink, appearing to read "A. Deuskar", written over a horizontal line.

**Principal**  
**AISSMS College of Pharmacy**  
**Pune-1**

## i. Acknowledgement

We, Upendra Deuskar & Associates are grateful to Mr. Malojiraje Chhatrapati Hon. Secretary of AISSMS Group, Shivajinagar Pune for giving us an opportunity to contribute in their efforts towards efficient energy management by undertaking this Energy Audit exercise.

We acknowledge with thanks for the co-operation and support extended by management and operating personnel from client side during the audit exercise. Detailed discussions and interaction were held with plant personnel throughout the course of the audit and awareness of energy conservation was noted as exemplary. We would also like to place on record our sincere thanks and appreciation for all plant executives.

We are also thankful to the other staff members who were actively involved while collecting the data and conducting the field studies. We take this opportunity to also thank all the team members at various departments associated with this study of energy audit for extending co-operation during collection of on-site data.

We trust that the findings of this study will help plant management in improving the equipment performance thereby giving optimum energy consumption at the premise.

## ii. Energy Audit Team

Upendra Deuskar &  
Associates  
AISSMS Group

Mr. Upendra G. Deuskar (BEE Certified Energy Auditor)  
Mr. Sunny Pangire  
Mr. Sachin S. Kulkarni-Chief Executive Officer  
Mr. Shivaji Patil-Project Manager

Date of Measurement

15<sup>th</sup> Nov, 2022

## iii. Instruments

1. Power Quality Analyzer
2. Ultrasonic Flow meter
3. Thermal Imager
4. Temperature – RH logger
5. Lux Meter
6. Power Clamp Meter
7. Measuring Tape



*Upendra Deuskar*

**Principal**  
AISSMS College of Pharmacy  
Pune-1

## iv. Executive Summary

AISSMS group of colleges (Client) has decided to do detailed energy audit of their premise at Kennedy Road ( Near RTO), Pune, Maharashtra. Client has already implemented most of energy efficiency measure into their premises. Client is focusing on energy savings and successful in reducing their energy demand.

Following are some energy saving and sustainability approach driven measures that are taken by college management.


1. Replacement of fluorescent lights with energy efficient LED lights.
2. Selection of Energy Efficient Equipment's (BEE 5 Star Labeled) whenever replacement of any equipment is to be done.
3. College is also maintaining energy consumption records of each section to track energy consumption of the premise.
4. Use of Solar energy for water heating purpose instead of electric geysers.
5. Use of Solar Photovoltaic system to generate own electricity using rooftop area available at the premise.

The action taken for energy conservation measures and use of renewable energy by the college management shows the sustainable approach towards energy use and environment friendly behaviour which is appreciable.

Other energy saving measures & cost saving measures

Although the college management is doing well in energy efficiency area further improvements can be done by the management for additional savings-

1. Use of aerators for water taps.
2. Use of heat pumps wherever possible in college premises for cooling and heating.
3. Fine tuning of Automatic Power Factor Correction system to improve PF to unity & reduce billing units in kVAh billing system.



*[Handwritten Signature]*

**Principal**  
**AISSMS College of Pharmacy**  
**Pune-1**

# 1 Introduction

## 1.1 General Description of Facility

AISSMS Group of Colleges (Client) is located at Kennedy Road in Pune city area, Pune District of Maharashtra, India. The institutes are committed towards creating a community which is vibrant and which provides a lifelong learning experience and professional development, corporates, academicians, industrialists and the student community have lauded the efforts made by the All India Shri Shivaji Memorial Society to take the Society to unscaled heights.

At present the campus has multiple colleges in one premise and description of area is provided below.


- College of Engineering having built-up area of about 23888 sq.m.
- College of Polytechnic having built-up area of about 11340 sq.m.
- College of Pharmacy having built-up area 7178 sq.m
- College of Business Management having built-up area 3626 sq.m.

## 1.2 Objectives

- To undertake an energy audit so as to identify areas for energy saving, both without and with investment.
- To prioritize distinct areas identified for energy savings depending upon saving potential, skills, and time frame for execution, investment cost, paybacks etc.

## 1.3 Scope of Work

- To correlate monthly data of production with electricity, fuels & water consumption, for a period of 12 months of normal operation to establish bench mark values for energy consumption.
- To study electrical energy metering, monitoring and control system existing at the plant and to recommend a suitable system for future monitoring.
- To study monthly power factor, maximum demand, working hours, load factor etc. for the reference period along with monthly electricity consumption and establish scope for MD control through possible optimization of load factor and through detailed load management study.
- Based on above, to evaluate the possibility of replacing major motors with energy efficient motors. To provide cost benefit analysis for the replacement policy.
- To study existing requirements of energy provisions at present locations and to identify distinct possibilities of rationalization / savings.
- To study existing maintenance practices for utility systems and recommend areas for improvement in energy efficiency / savings.
- To identify, evaluate and priorities energy saving opportunities into short, mid and long-term time spans depending upon investments, quantum of savings, skills and time required for implementation, etc.
- To prepare draft energy audit report, present to management, undertake necessary modifications based on presentation meeting and submit the final report.



*Handwritten signature of the Principal*

**Principal**  
**AISSMS College of Pharmacy**  
**Pune-1**

### 1.4 Energy Source and Breakup

College campus is having diesel generator for emergency power supply and the share of diesel consumption is about 5 % of total energy consumption. Energy consumption breakup & energy breakup on the basis of source of energy are provided below.

Energy Consumption Breakup

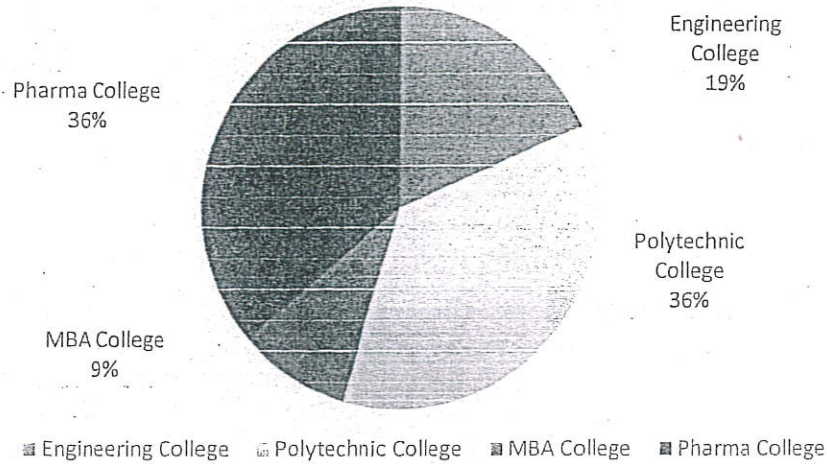


Figure 1 Energy Consumption Breakup

College is having rooftop solar system of 300 kWp and energy generation by the solar PV plant is having major share in the energy supply to the premise. Breakup of the same is represented below.

Energy Source Breakup


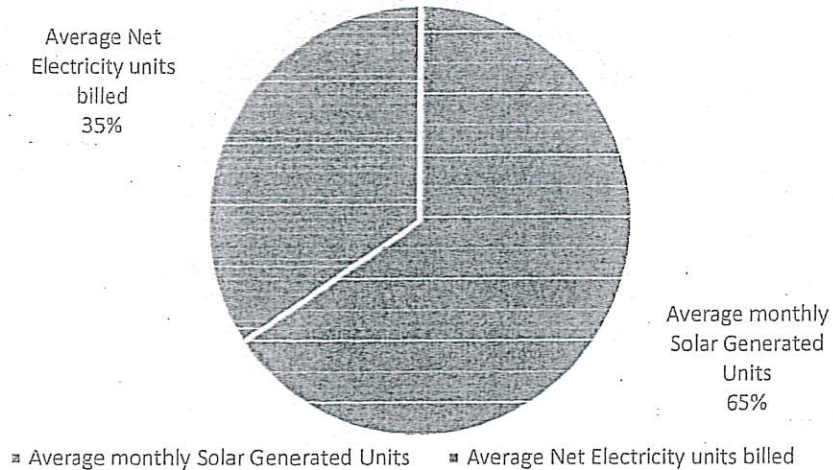


Figure 2 Energy Source Breakup



*Upendra Deuskar*  
**Principal**  
 AISSMS College of Pharmacy  
 Pune-1



1.5 Electricity Consumption

Client is receiving electricity supply from Maharashtra State Electricity Distribution Company Limited (MSEDCL) with contract demand of 400 KVA & 11kV/433 V, 630 KVA Transformer .

Following table represents bill analysis for last 12 months energy use of the facility.

Table 1-Bill Analysis – Last 12 months


Month	Billed Demand	Highest Recorded MD	Energy Consumption		Power Factor	Demand Charges	Energy Charges	Total Current Bill	Excess Payment due to higher contract Demand
	kVA	kVA	kWh	kVAh		Rs.	Rs.	Rs.	Rs.
May-21	240	39	11310	11538	0.98	103680	106265	261546	86832
Jun-21	240	49	13458	13678	0.98	103680	125974	288491	82512
Jul-21	NA	NA	NA	16328	NA	NA	NA	NA	NA
Aug-21	NA	NA	NA	13828	NA	NA	NA	NA	NA
Sep-21	240	83	16025	17495	0.91	103680	161129	333788	67824
Oct-21	NA	NA	NA	20260	NA	NA	NA	NA	NA
Nov-21	NA	NA	NA	16420	NA	NA	NA	NA	NA
Dec-21	NA	NA	NA	16898	NA	NA	NA	NA	NA
Jan-22	NA	NA	NA	14470	NA	NA	NA	NA	NA
Feb-22	240	81	18683	18860	0.99	103680	173700	350979	68688
Mar-22	NA	NA	NA	30550	NA	NA	NA	NA	NA
Apr-22	NA	NA	NA	28565	NA	NA	NA	NA	NA
<b>Total</b>	-	-	<b>59,476</b>	<b>218,890</b>	-	<b>414,720</b>	<b>567,068</b>	<b>1,234,804</b>	<b>3,05,856</b>
<b>Average</b>	<b>240</b>	<b>63</b>	<b>14,869</b>	<b>18,241</b>	<b>0.96</b>	<b>103,680</b>	<b>141,767</b>	<b>308,701</b>	<b>76,464</b>

Average monthly MSEDCL unit's consumption is 18,241 units and avg. monthly bill is Rs. 3.08 Lakh.

Average of last 12 months unit cost is Rs. 16.92 / kVAh.

Average PF is at 0.96 & shall be improved to 0.995 for reduced kVAh billed.

No leakage currents were observed in the facility in the various feeders.



*(Handwritten Signature)*

**Principal**  
**AISSMS College of Pharmacy**  
**Pune-1**

Energy consumption trend represented in graphical format as below-

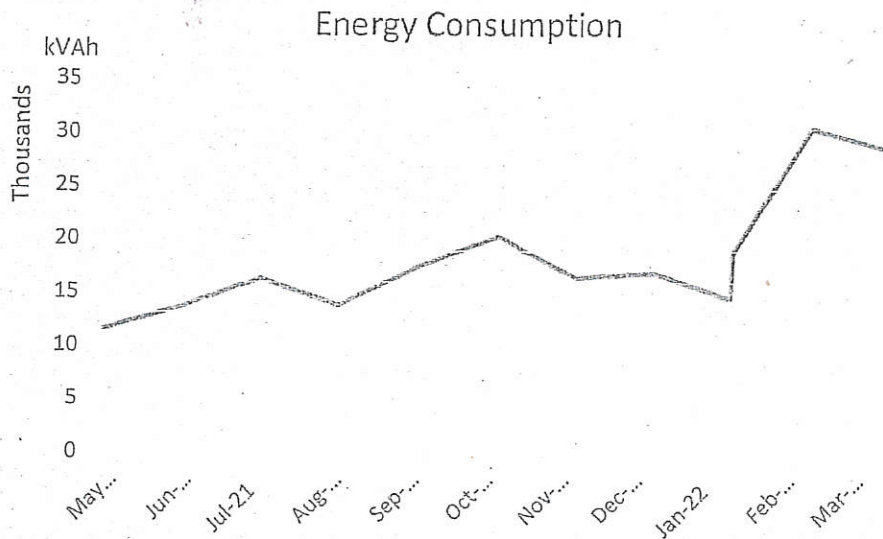


Figure 3- Energy Consumption Trend

• The Electricity bill consist of following parts:-

Demand charges – Maximum Peak Demand (in terms of KVA) is recorded in the bill for the complete month and a fixed charge of Rs. 432/- per KVA

Unit charges – As per the units consumed Industrial tariff are applicable.

Time of Day Charges -- Depending on the time of day of usage, the Time of Day charges adjustment is made.

Other charges, which cannot be controlled

• The following are the conclusions of Electrical Bill Analysis:

1. Considering data available, average cost of electricity is Rs. 16.92 / kVAh.
2. Average billed Power factor is 0.96 (Based on available data). The power factor is maintained but can be improved to near unity value.
3. As contract demand is 400 kVA, minimum billed Demand is 240 kVA (60% of contract demand). Even though the actual maximum demand is lower (due to higher contract demand) extra Maximum Demand charges are being paid. It is recommended to reduce the contract demand so as to reduce the Maximum Demand charges. Average monthly loss of Rs. 76,464\*/- is being incurred due to higher contract demand.

\*Value based on available data



*[Signature]*  
Principal  
AISSMS College of Pharmacy  
Pune-1

### 1.6 Water Consumption

College campus is having 5 water connections and average water consumption per billing cycle for the premise is represented below.

Table 2- Average Water consumption

Month	connection no.				
	ST005483	SE025101	SE025102	ST005483	SE025620
	kL	kL	kL	kL	kL
Average Water Consumption	882	91	241	244	237

### 1.7 Harmonics Study

Harmonic of a wave is the wave which has frequency as the positive integer multiple of the frequency of the original wave, known as the fundamental frequency.



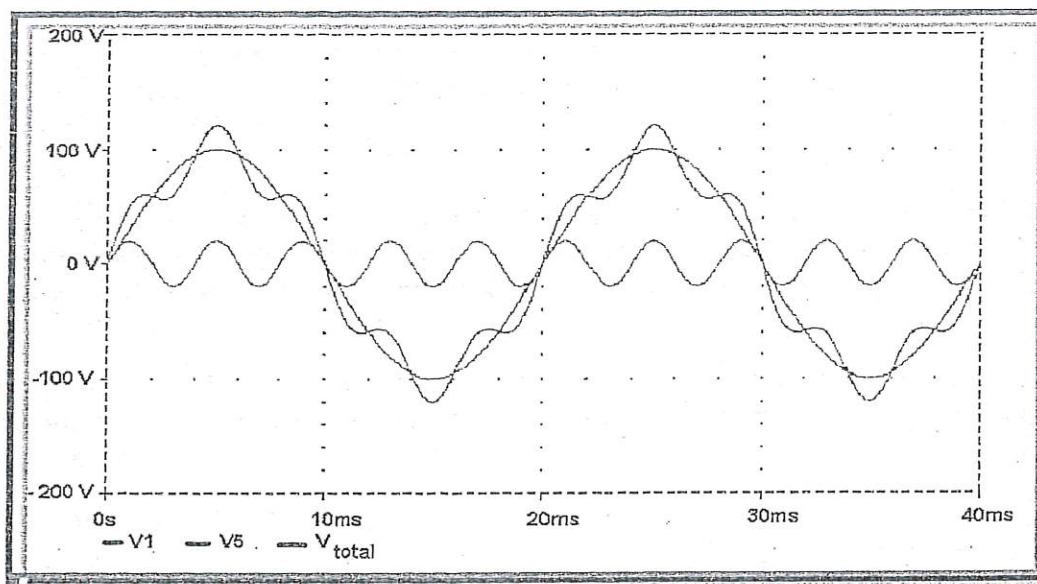


Figure 4- Harmonics



*[Handwritten Signature]*

Principal  
AISSMS College of Pharmacy  
Pune-1

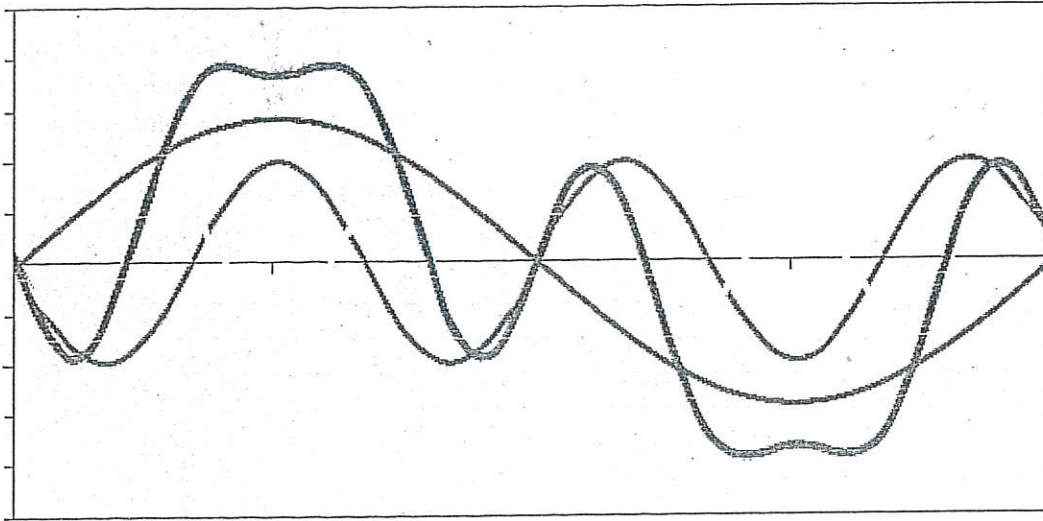

$V_1$  – 1<sup>st</sup> Harmonic (Fundamental wave)

$V_5$  – 5<sup>th</sup> Harmonic

$V_3$  – 3<sup>rd</sup> harmonic

$V$  total – Resultant Wave form

Figure 5-. Harmonics Generation

Electrical loads can be classified as linear and non-linear loads. A linear load is one, which draws a sinusoidal current when subjected to sinusoidal voltage. The current wave may or may not have a phase difference with respect to the voltage. A pure resistance, inductance or capacitance or any combination of these forms a linear load. On the contrary, a non-linear load is one, which draws non-sinusoidal or pulsating current when subjected to sinusoidal voltage.

Any non-sinusoidal current can be mathematically resolved into a series of sinusoidal components (Fourier series). The first component is called as fundamental and the remaining components whose frequencies are integral multiples of the fundamental frequency are known as harmonics. If the fundamental frequency is 50 Hz, then 2nd harmonic will have a frequency of 100Hz and the 3rd will have 150Hz and so on.

Non-linear loads that draw current in abrupt pulses rather than a smooth sinusoidal manner create harmonics. The pulses of current cause distorted current wave shape, which in turn cause harmonic currents to flow back into other parts of the power system.

### 1.7.1 Voltage Harmonics

Main reason for voltage harmonics is current harmonics. The voltage wave form from voltage source is distorted by the current harmonics due to source impedance. Larger the source impedance, higher will be the voltage harmonics caused by current harmonics. It is typically the case that voltage harmonics are indeed small compared to current harmonics. Thus, harmonic voltage can be defined as the product of harmonic current and source impedance at the harmonic frequency.

The source impedance includes the Impedance of the power source (Transformer, Generator, and Grid etc.), Impedance of the Bus bars, Cables, Switchgears and other loads in the network.

Following are some of the non-linear loads, which generate harmonics:

- ❖ Static power converters and rectification circuits, which are used in ups, battery chargers, etc.
- ❖ Arc furnaces
- ❖ Power electronics drivers for motor controls (AC/DC) drives.



*Handwritten signature*

**Principal**  
AISSMS College of Pharmacy  
Pune-1

- ❖ Computers
- ❖ Television receivers
- ❖ Saturated transformers
- ❖ Fluorescent lighting
- ❖ Telecommunication equipment's

Table 3- Voltage Harmonics level at Engineering College

Voltage Harmonics	R	Y	B
THD	1.60	1.88	1.64
3rd Level Harmonics	0.15	0.32	0.13
5th Level Harmonics	0.46	0.59	0.38
7th Level harmonics	1.25	1.60	1.30
9th Level harmonics	0.50	0.19	0.48
11th Level harmonics	0.62	0.61	0.70
13th Level harmonics	0.21	0.22	0.26

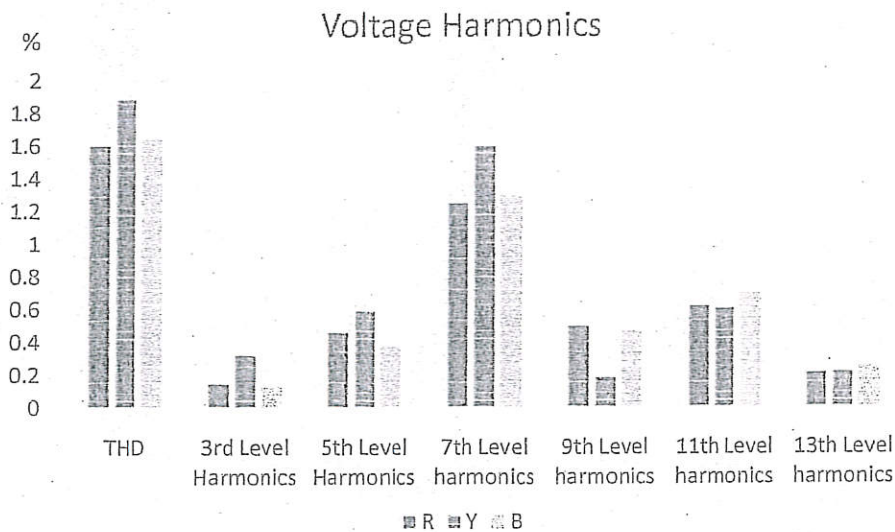


Figure -6. Voltage Harmonics Profile – Engineering College

**Observations:**

- It is observed that the voltage harmonics for engineering college is within limit which is 1.88 % which is acceptable as standard value of 5% (voltage harmonics ( $V_{THD}$  %) limit as per IEEE 519:2014 standards).



*(Signature)*  
**Principal**  
 AISSMS College of Pharmacy  
 Pune-1

Table 4-. Voltage Harmonics level at Management College

Voltage Harmonics	R	Y	B
THD	1.68	1.77	1.60
3rd Level Harmonics	0.18	0.29	0.16
5th Level Harmonics	0.33	0.34	0.29
7th Level harmonics	1.43	1.58	1.23
9th Level harmonics	0.36	0.11	0.62
11th Level harmonics	0.67	0.56	0.69
13th Level harmonics	0.19	0.22	0.19

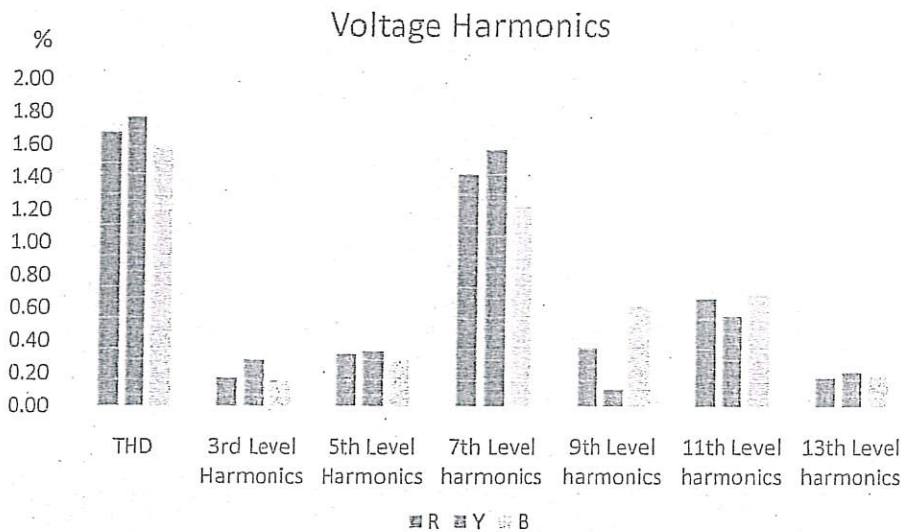



Figure7. Voltage Harmonics Profile – Management College

Observations:

- It is observed that the voltage harmonics for engineering college is within limit which 1.77 % which is acceptable as standard value of 5% (voltage harmonics ( $V_{THD}$  %) limit as per IEEE 519:2014 standards).

Table 5. Voltage Harmonics level at College of Pharmacy

Voltage Harmonics	R	Y	B
THD	1.63	1.78	1.62
3rd Level Harmonics	0.18	0.31	0.15
5th Level Harmonics	0.28	0.27	0.23
7th Level harmonics	1.37	1.58	1.30
9th Level harmonics	0.36	0.17	0.50
11th Level harmonics	0.66	0.58	0.71
13th Level harmonics	0.18	0.26	0.23



*Upendra Deuskar*  
Principal  
AISSMS College of Pharmacy  
Pune-1

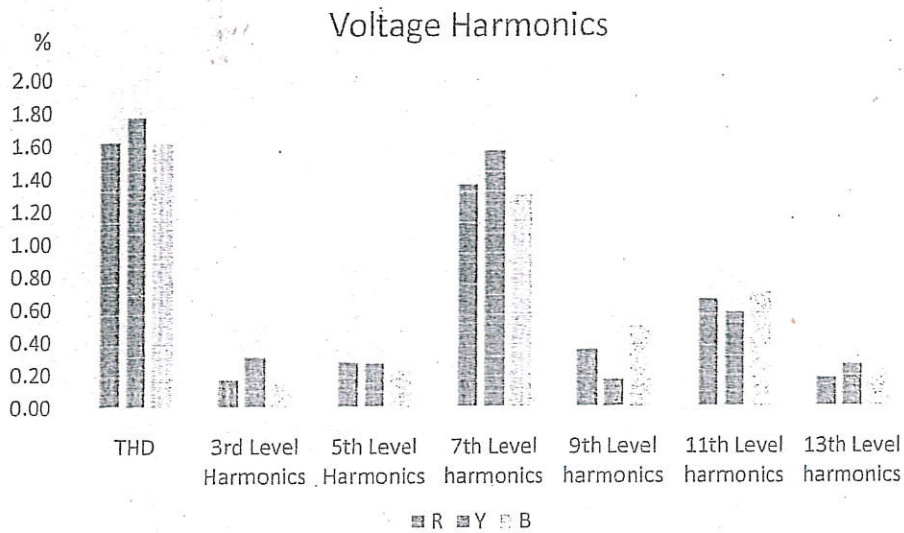



Figure 8-. Voltage Harmonics Profile – College of Pharmacy


**Observations:**

- It is observed that the voltage harmonics for engineering college is within limit which 1.78 % which is acceptable as standard value of 5% (voltage harmonics ( $V_{THD}$  %) limit as per IEEE 519:2014 standards).

Table 6. Voltage Harmonics level at Polytechnic College

Voltage Harmonics	R	Y	B
THD	1.49	1.61	1.49
3rd Level Harmonics	0.24	0.22	0.06
5th Level Harmonics	0.52	0.43	0.44
7th Level harmonics	1.31	1.28	1.04
9th Level harmonics	0.31	0.35	0.27
11th Level harmonics	0.44	0.62	0.67
13th Level harmonics	0.21	0.20	0.14



  
**Principal**  
**AISSMS College of Pharmacy**  
**Pune-1**

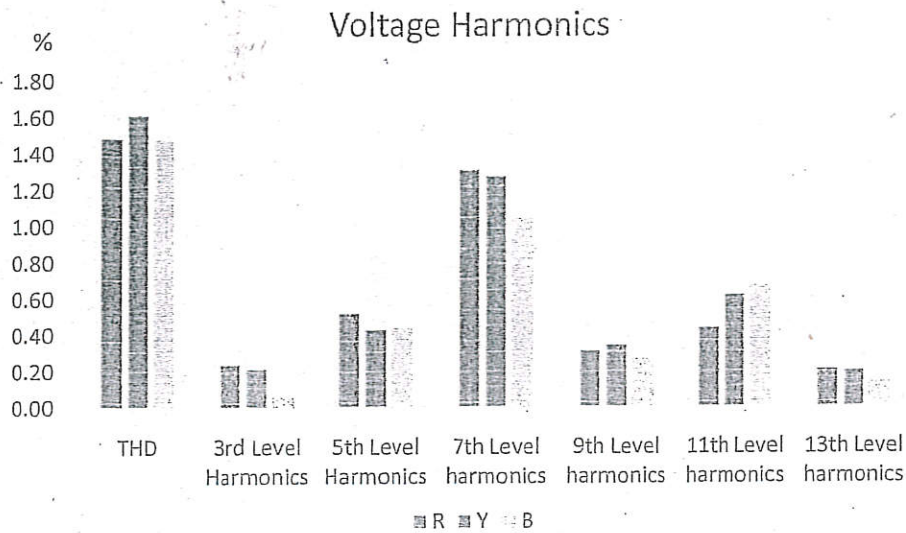


Figure 9- Voltage Harmonics Profile – Polytechnic College

**Observations:**

- It is observed that the voltage harmonics for engineering college is within limit which 1.49 % which is acceptable as standard value of 5% (voltage harmonics ( $V_{THD}$  %) limit as per IEEE 519:2014 standards).


**1.7.2 Current Harmonics**

In a normal alternating current power system, the current drawn by a linear load will be sinusoidal at the specified frequency. The current wave may or may not have a phase difference with respect to the voltage. Current harmonics are caused by non-linear loads which draw current that is not necessarily sinusoidal. The current wave form can be distorted and complex depending on the load and the interaction between other components of the system. Using Fourier series, the complex wave form can be resolved into simple sinusoidal waves of multiple frequency for analysis purpose.

Any non-sinusoidal current can be mathematically resolved into a series of sinusoidal components (Fourier series). The first component is called as fundamental and the remaining components whose frequencies are integral multiples of the fundamental frequency are known as harmonics. If the fundamental frequency is 50 Hz, then 2<sup>nd</sup> harmonic will have a frequency of 100Hz and the 3<sup>rd</sup> will have 150Hz and so on.

Table 7- Current Harmonics Level – Engineering College

Current Harmonics	R	Y	B
THD	80.36	119.70	142.25
3rd Level Harmonics	30.97	17.53	23.12
5th Level Harmonics	50.91	76.89	81.06
7th Level harmonics	39.24	74.16	80.22
9th Level harmonics	30.01	33.44	63.80
11th Level harmonics	15.36	29.58	39.06
13th Level harmonics	10.30	19.33	22.74



*Upendra Deuskar*  
Principal  
AISSMS College of Pharmacy  
Pune-1



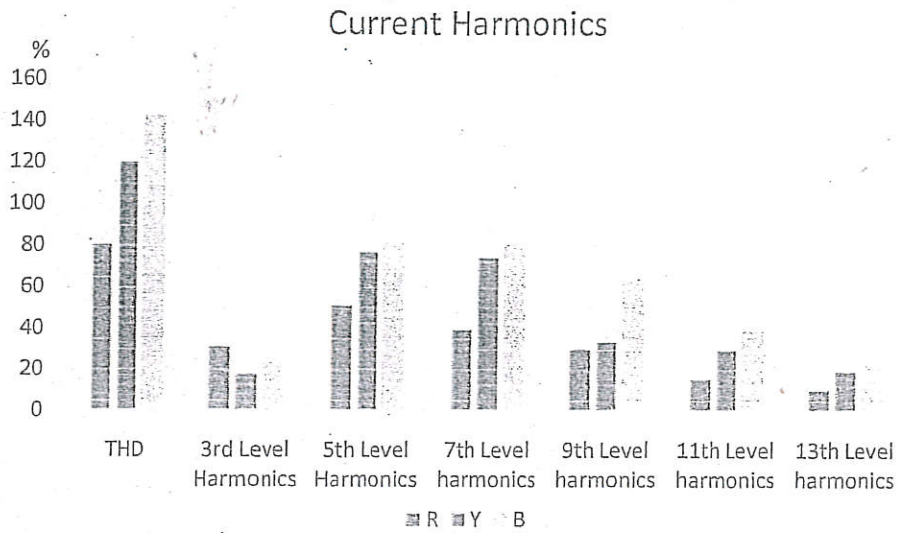



Figure 10- Current Harmonics-Engineering College

**Observations:**

- It is observed that THD is 142 % which is on higher side than standard value of 8% (Current harmonics ( $I_{THD}$  %) limit as per IEEE 519:2014 standards).

Table 8- Current Harmonics Level – Management College

Current Harmonics	R	Y	B
THD	12.91	21.55	14.61
3rd Level Harmonics	10.73	4.29	13.16
5th Level Harmonics	3.49	9.60	3.05
7th Level harmonics	3.37	13.69	3.00
9th Level harmonics	3.19	9.98	3.42
11th Level harmonics	1.89	4.77	1.09
13th Level harmonics	1.39	1.82	1.47



*(Handwritten Signature)*

**Principal**  
**AISSMS College of Pharmacy**  
**Pune-1**

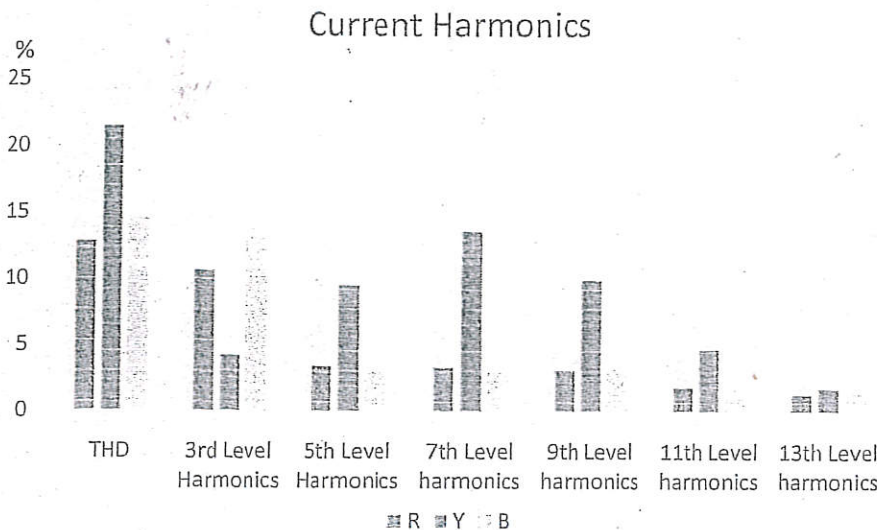



Figure 11- Current Harmonics – Management College

**Observations:**

It is observed that THD is 21 % which is on higher side than standard value of 8% (Current harmonics ( $I_{THD}$  %) limit as per IEEE 519:2014 standards).

Table 9- Current Harmonics Level – College of Pharmacy

Current Harmonics	R	Y	B
THD	13.65	11.80	12.71
3rd Level Harmonics	7.50	2.65	4.47
5th Level Harmonics	8.43	5.81	8.38
7th Level harmonics	4.40	7.04	4.11
9th Level harmonics	4.24	3.92	5.41
11th Level harmonics	2.92	4.18	3.76
13th Level harmonics	1.81	2.86	1.42



*Handwritten signature of the Principal*

**Principal**  
**AISSMS College of Pharmacy**  
**Pune-1**

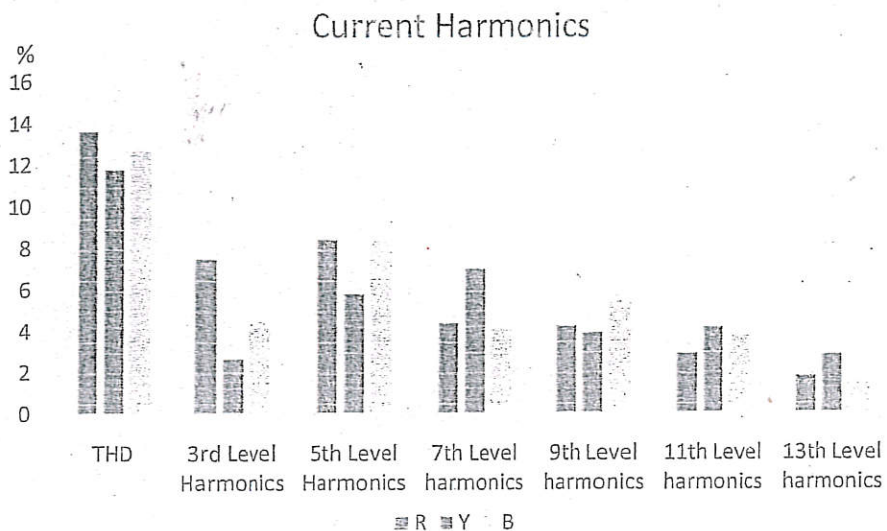


Figure 12- Current Harmonics – College of Pharmacy


**Observations:**

It is observed that THD is 13 % which is on higher side than standard value of 8% (Current harmonics ( $I_{THD}$  %) limit as per IEEE 519:2014 standards).

Table 10- Current Harmonics Level – Polytechnic College

Current Harmonics	R	Y	B
THD	13.65	12.97	22.79
3rd Level Harmonics	5.78	3.05	9.30
5th Level Harmonics	9.12	9.71	14.16
7th Level harmonics	6.99	5.71	9.56
9th Level harmonics	3.91	4.96	9.96
11th Level harmonics	0.81	0.49	3.47
13th Level harmonics	1.12	1.22	1.64



  
**Principal**  
**AISSMS College of Pharmacy**  
**Pune-1**

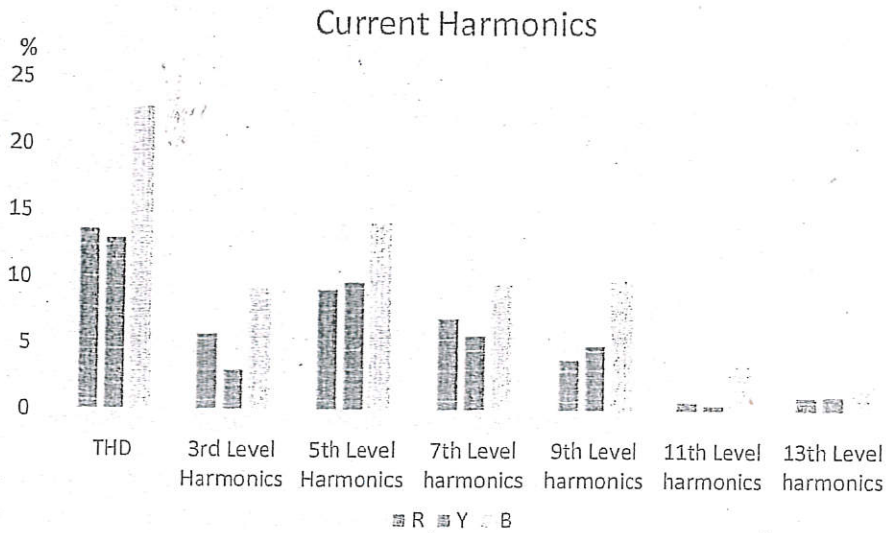


Figure 13- Current Harmonics – Polytechnic College

**Observations:**

It is observed that THD is 13.6 % which is on higher side than standard value of 8% (Current harmonics ( $I_{THD}$  %) limit as per IEEE 519:2014 standards).

**1.7.3 Limits of Harmonics**


IEEE recommended practices and requirements for harmonic control in electrical power system: It represents a standard level of acceptable harmonic distortion in a power system.


Table 11-Harmonics Distortion Limits: – IEEE – 519C:2014

$I_{sc}$	Short Circuit current at the point of common coupling (PCC), under normal operating conditions
$I_L$	Fundamental full load current in Amps
H	Harmonic number
$11 < h < 17$	Limits of individual current at PCC
THD	Total harmonic distortions

Table 12- Current distortion limits for systems rated 120 V to 69 kV – User's responsibility

Maximum harmonic current distortion in percent of $I_L$						
Individual harmonic order (odd harmonics)						
$I_{sc}/I_L$	$3 \leq h < 11$	$11 \leq h < 17$	$17 \leq h < 23$	$23 \leq h < 35$	$35 \leq h < 50$	TDD




  
**Principal**  
**AISSMS College of Pharmacy**  
**Pune-1**

Maximum harmonic current distortion in percent of $I_L$						
Individual harmonic order (odd harmonics)						
$I_{sc}/I_L$	$3 \leq h < 11$	$11 \leq h < 17$	$17 \leq h < 23$	$23 \leq h < 35$	$35 \leq h < 50$	TDD
<20*	4.0	2.0	1.5	0.6	0.3	5.0
20<50	7.0	3.5	2.5	1.0	0.5	8.0
50<100	10.0	4.5	4.0	1.5	0.7	12
100<1000	12.0	5.5	5.0	2.0	1.0	15
>1000	15.0	7.0	6.0	2.5	1.4	20

\*All power generation equipment is limited those values regardless their  $I_{sc}/I_L$ .

- Odd harmonics are represented as % of fundamental at PCC
- Even harmonics are limited to 25% of odd harmonic's limits.



*[Handwritten Signature]*

**Principal**  
AISSMS College of Pharmacy  
Pune-1

## 2 Power Parameter Profiles

### 2.1 Power Parameter Profiles

All electrical parameters for individual feeders were logged using 3 phase electrical data logger. The logging was conducted at all feeders from main panel for evaluation of load in each section. Voltage, Current, Power and power factor profile with other electrical measurements were carried out at the main incomer coming of installed Transformer using a Power Quality Analyser. The profiles for the each section/feeders are given below.

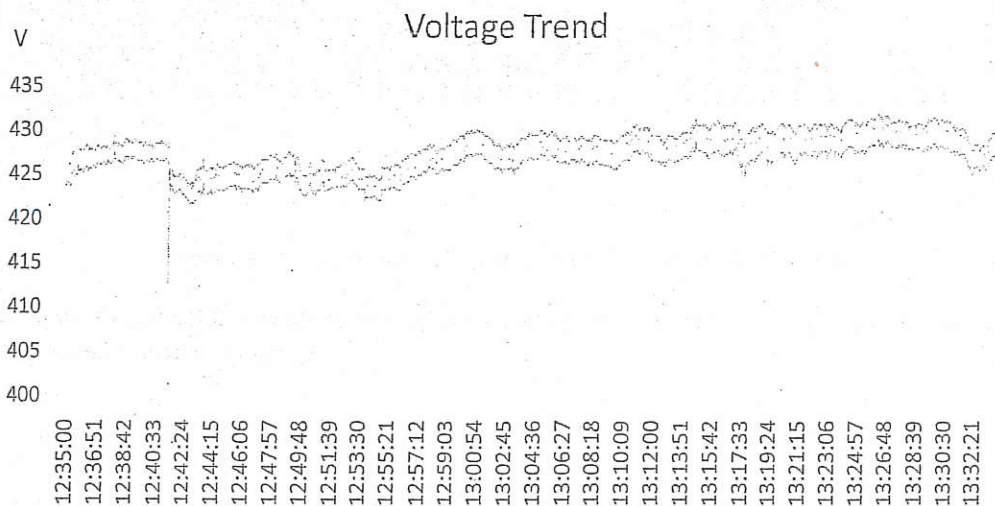


Figure 14- Engineering College Voltage Profile

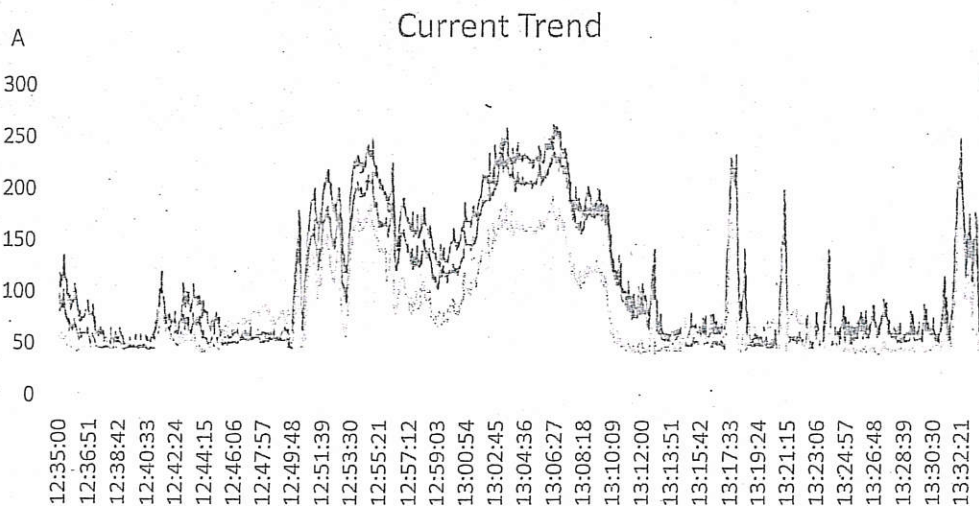


Figure 15- Engineering College Current Profile



*[Signature]*  
**Principal**  
 AISSMS College of Pharmacy  
 Pune-1

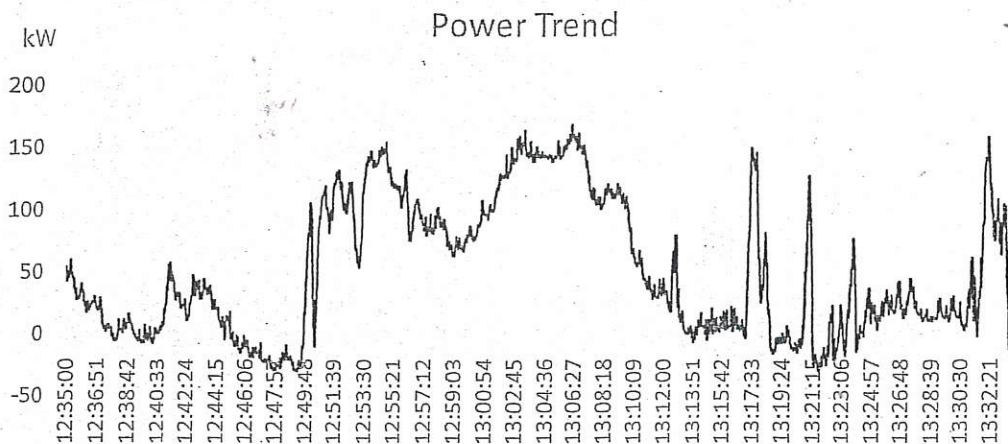


Figure 16- Engineering College Power Consumption Profile – kW

Whenever there was net export of electricity due to solar power generation exceeding the actual consumption negative power consumption was observed in graph.

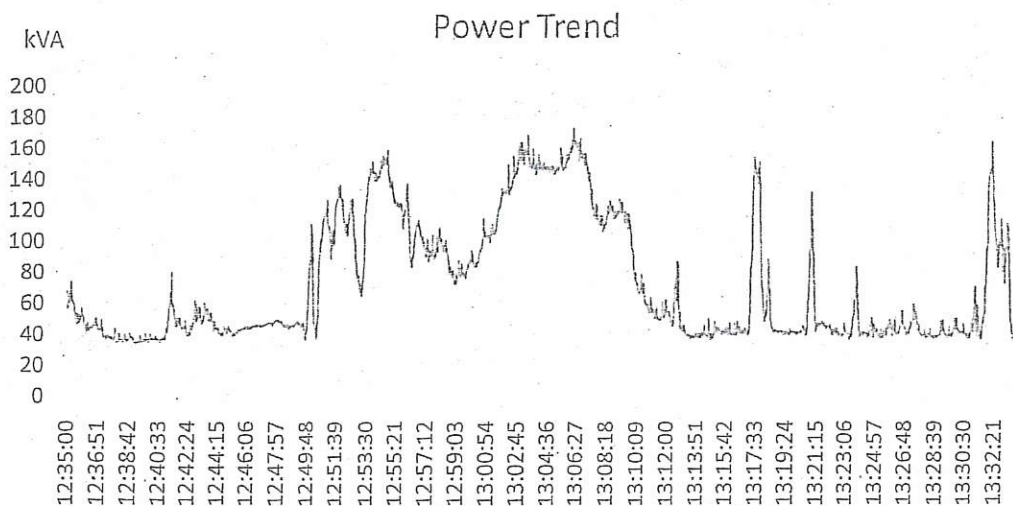


Figure 17- Engineering College Power Consumption Profile – kVA



*Upendra Deuskar*  
**Principal**  
 AISSMS College of Pharmacy  
 Pune-1

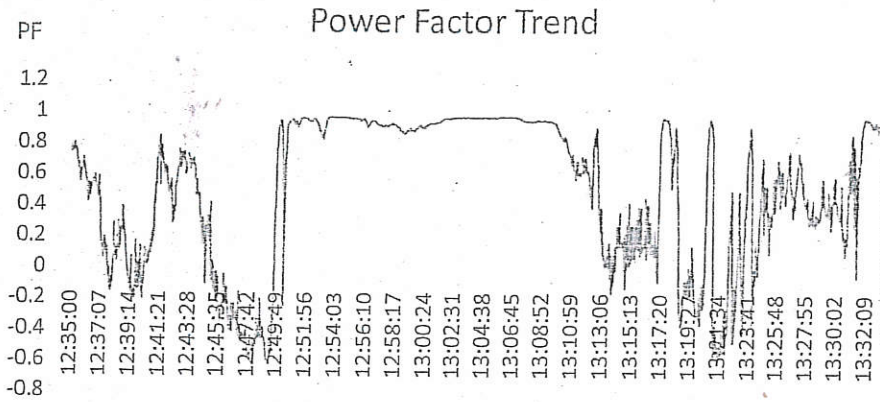


Figure 18- Engineering College Power Factor Profile

As it can be clearly seen in above graph that Power factor variation is due to additional capacitance being generated in the electrical system causing leading PF. However when these loads are less the power factor is varying both on inductive and capacitive side due to switching of capacitors. Fine tuning of the capacitor banks is recommended in this case.


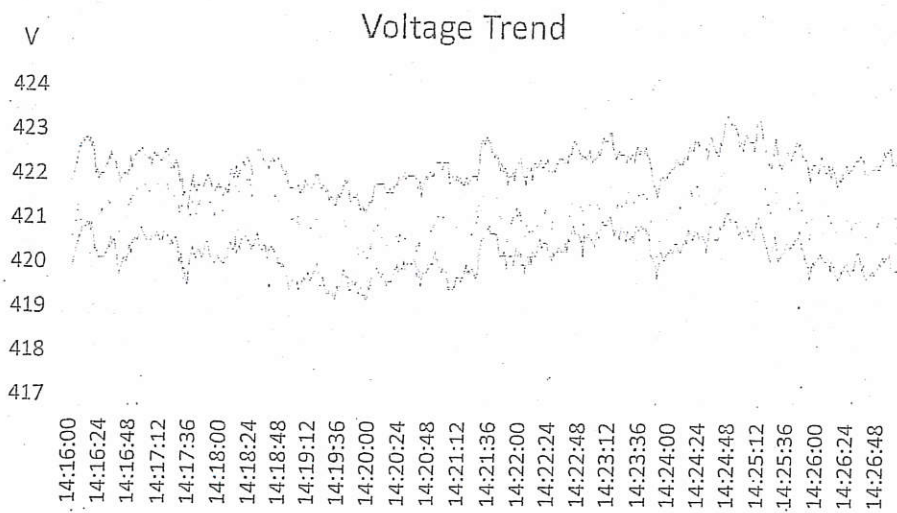


Figure 19-College of Management Voltage Profile



*Handwritten signature in blue ink.*

**Principal**  
**AISSMS College of Pharmacy**  
**Pune-1**



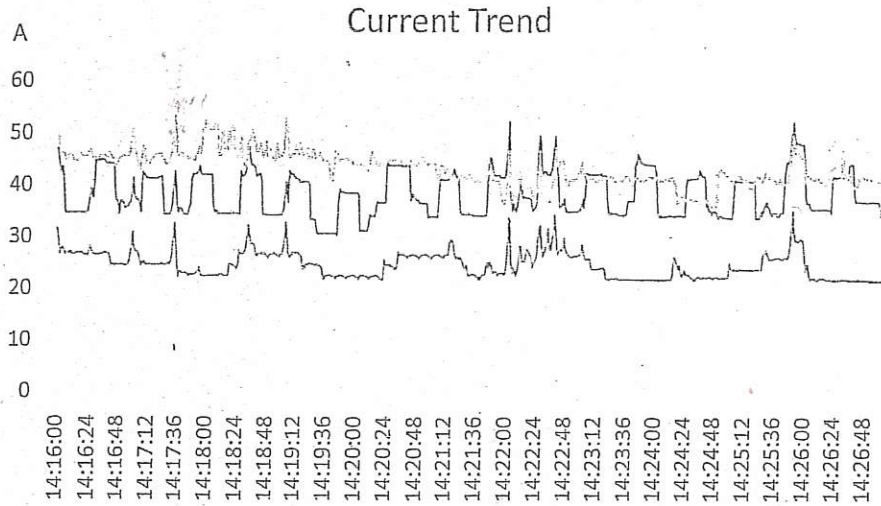


Figure 20- College of Management Current Profile

Current Unbalance of value ~ 31% was observed in the feeder & need to be resolved immediately.

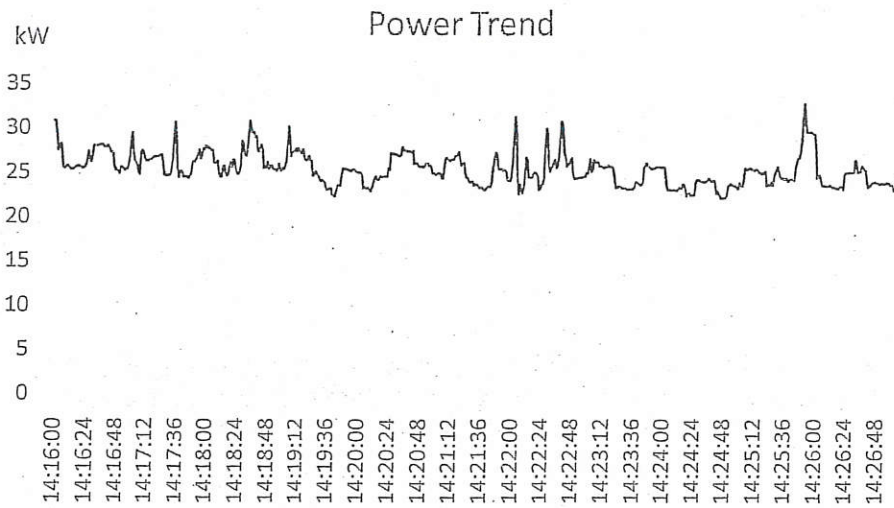


Figure 21- College of Management Power Consumption Profile – kW



Principal  
AISSMS College of Pharmacy  
Pune-1

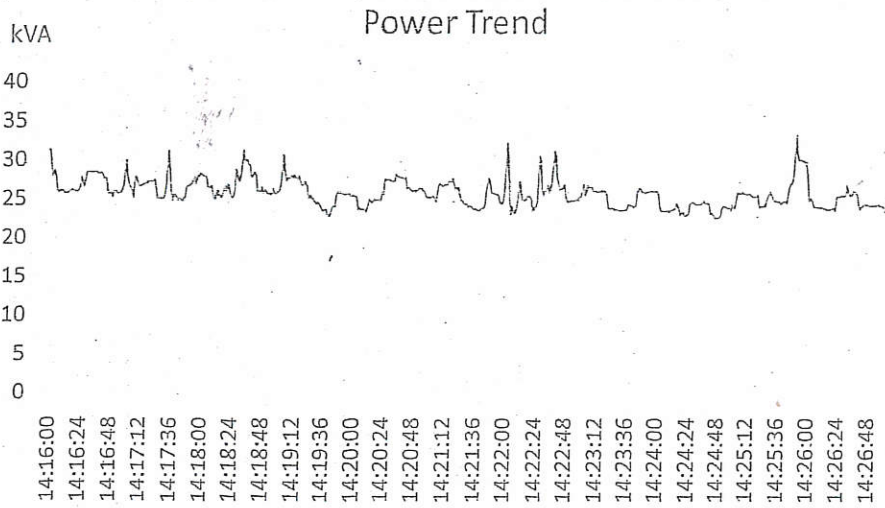


Figure 22-College of Management Power Consumption Profile – KVA

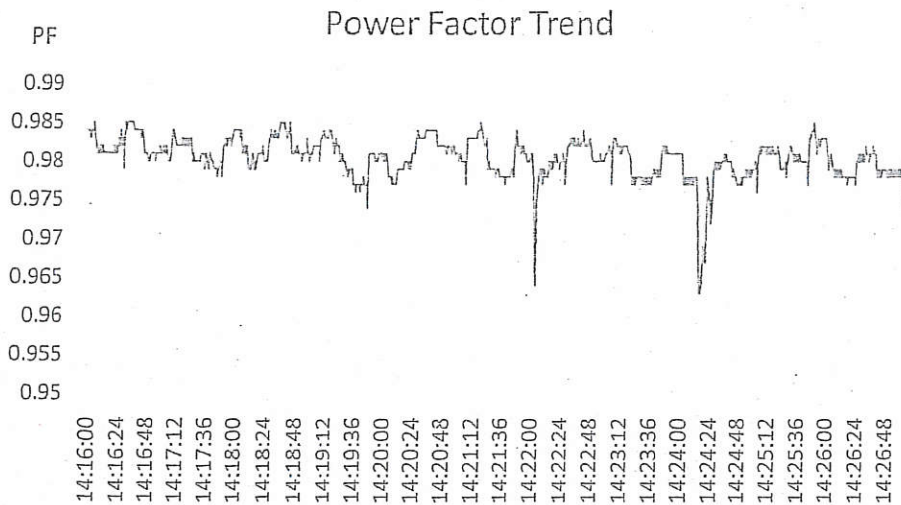


Figure 23-College of Management Power Factor Profile



*Handwritten signature*

**Principal**  
 AISSMS College of Pharmacy  
 Pune-1

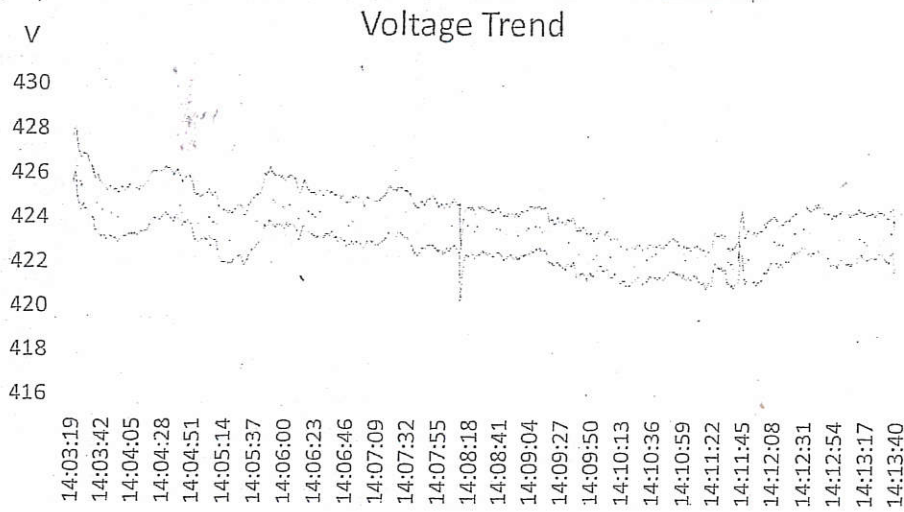


Figure 24- College of Pharmacy Voltage Profile

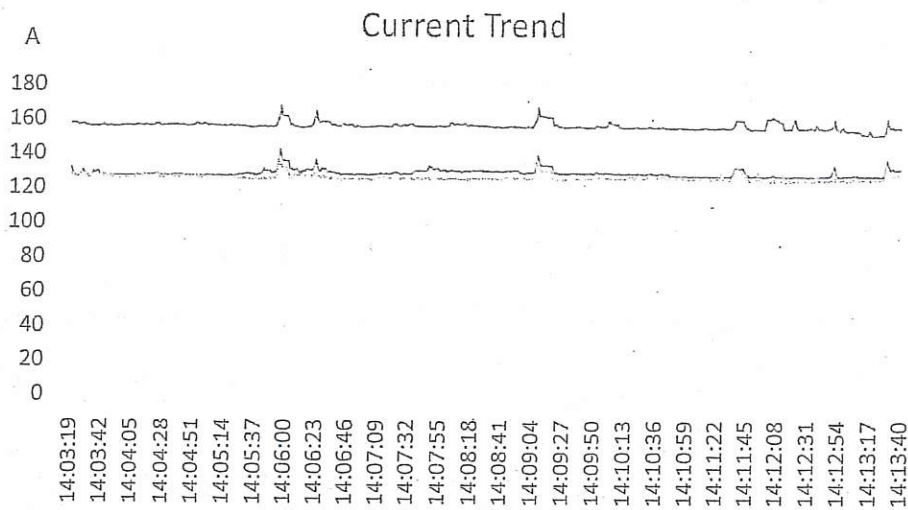


Figure 25- College of Pharmacy Current Profile

Current unbalance observed is 13% and need immediate attention.



Principal  
AISSMS College of Pharmacy  
Pune-1

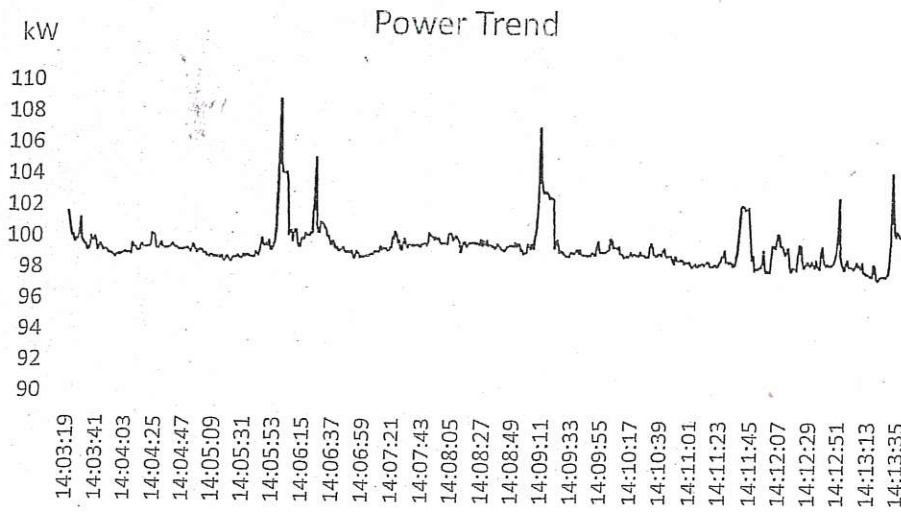


Figure 26- College of Pharmacy Power Consumption Profile – kW


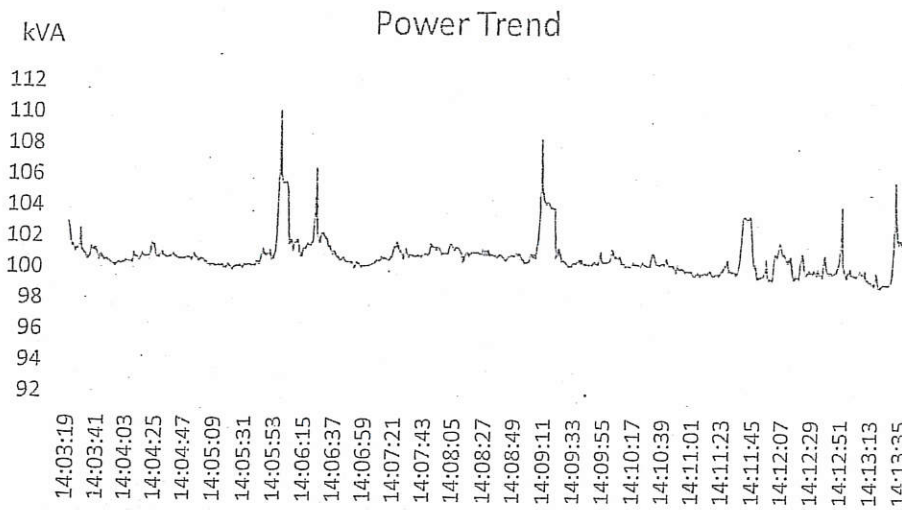


Figure 27-College of Pharmacy Power Consumption Profile – kVA



Principal  
AISSMS College of Pharmacy  
Pune-1

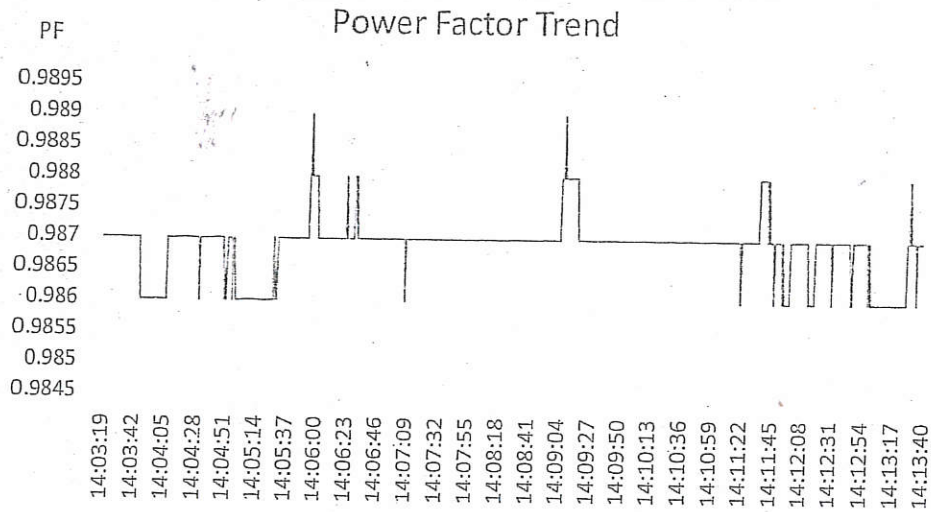


Figure 28- College of Pharmacy Power Factor Profile

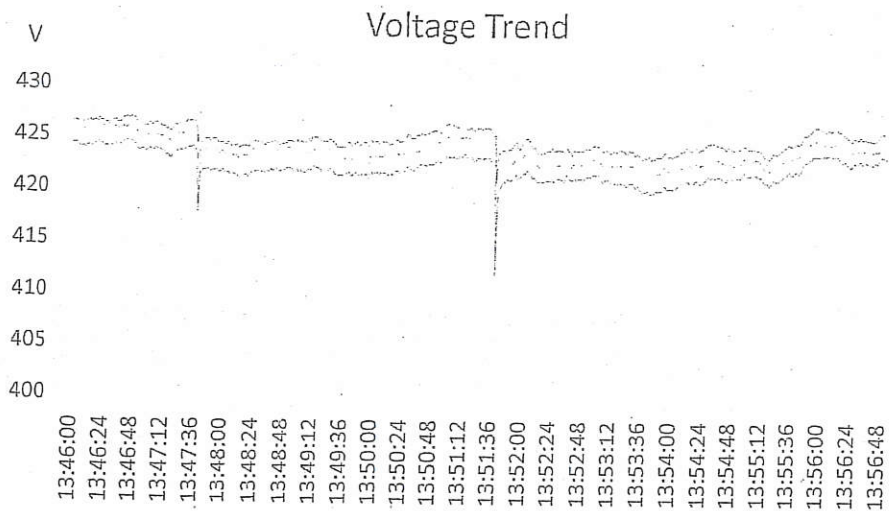


Figure 29- College of Polytechnic Voltage Profile



*Handwritten signature*

**Principal**  
**AISSMS College of Pharmacy**  
**Pune-1**

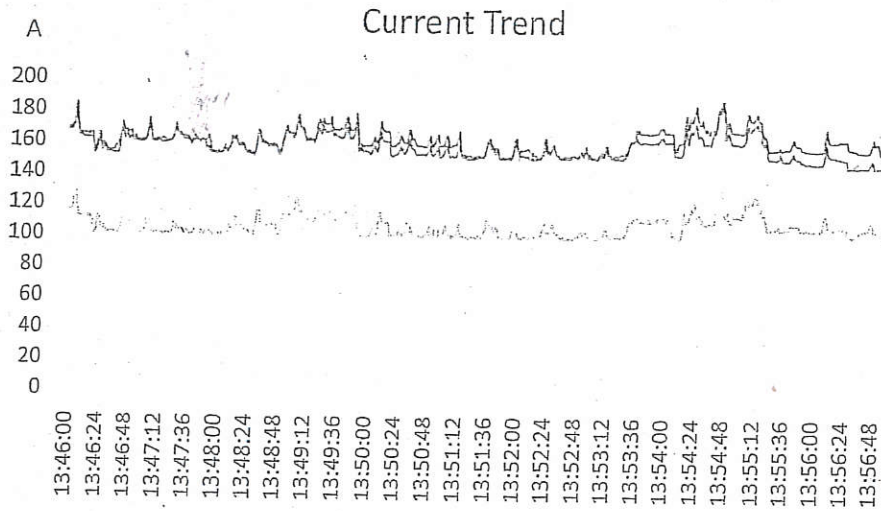


Figure 30- College of Polytechnic Current Profile

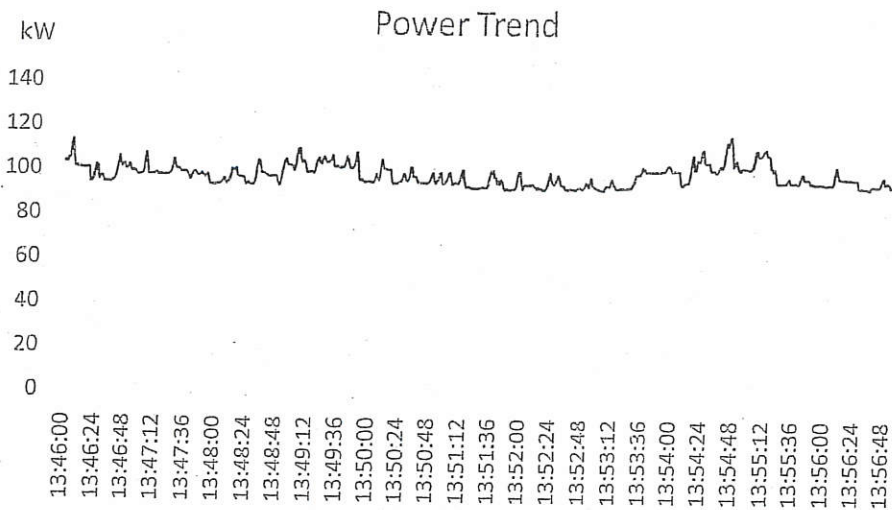


Figure 31-. College of Polytechnic Power Consumption Profile – kW



Principal  
AISSMS College of Pharmacy  
Pune-1

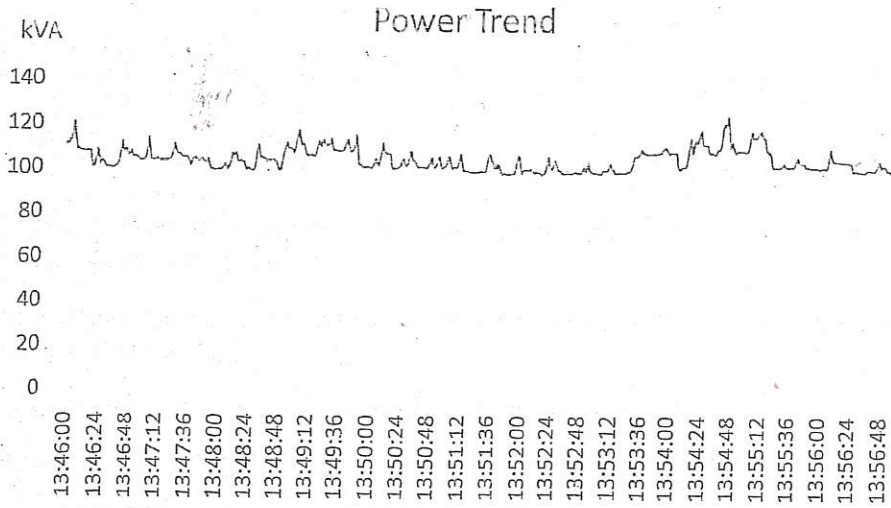


Figure 31-College of Polytechnic Power Consumption Profile – KVA


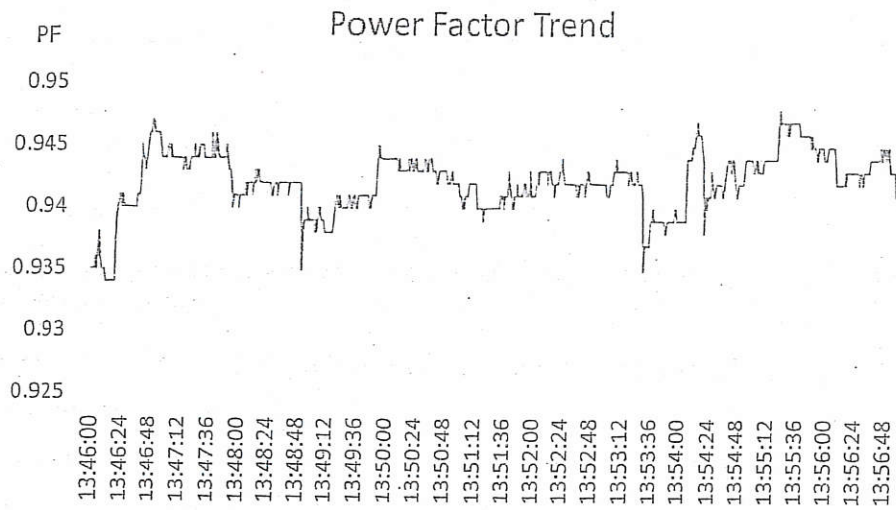


Figure 32- College of Polytechnic Power Factor Profile

Power Factor is in the range of 0.935 to 0.949 & can be improved.



*Upendra Deuskar*  
 Principal  
 AISSMS College of Pharmacy  
 Pune-1

### 3 Energy Conservation Measures

#### 3.1 Energy conservation measures already undertaken by college

College management is very keen on implementation of energy saving initiatives and have already implemented some energy conservation measures in the premise.

College management is also doing cleaning and maintenance best practices for improved performance of renewable energy systems installed in the premises.

Energy conservation measure which are under implementation stage are as follows.

1. Replacement of fluorescent lights with energy efficient LED lights.
2. Selection of Energy Efficient Equipment's (BEE 5 Star Labeled) whenever replacement of any equipment is to be done.
3. College is also maintaining energy consumption records of each section to track energy consumption of the premise.
4. Use of Solar energy for water heating purpose instead of electric geysers.
5. Use of Solar Photovoltaic system to generate own electricity using rooftop area available at the premise.


The action taken for energy conservation measures and use of renewable energy by the college management shows the sustainable approach towards energy use and environment friendly behaviour which is appreciable.

#### Other energy saving measures & cost saving measures

Although the college management is doing well in energy efficiency area further improvements can be done by the management for additional savings.

1. Use of heat pumps wherever possible in college premises for cooling and heating.
2. Use of aerators for water taps.
3. Cost saving measure - Fine tuning of Automatic Power Factor Correction system to improve PF to unity & reduce billing units in kVAh billing system.
4. Cost Saving measure - Reduce contract demand to last recorded highest demand to reduce the excess demand charges being paid each moth.

\*\*\*\*\*



*Handwritten signature in blue ink*

Principal  
AISSMS College of Pharmacy  
Pune-1





UPENDRA DEUSKAR & ASSOCIATES  
Electrical Consultants & Energy Auditors  
E/513, Ruikar Trust Building, Near S.T. Stand,  
Kolhapur-416001 Phone - Off.(0231) 2653072  
Cell : 9422044172, E-mail : upendraasso@gmail.com

Date-22-12-2022

**TO WHOSOEVER IT MAY CONCERN**

This is to certify that we had carried out the Energy & Water Audit in the Kennedy Road Campus of All India Shri Shivaji Memorial Society ( AISSMS ), Pune.

It was observed that client already have installed energy efficient equipment in their premise. Most of energy efficiency improvement work has been already done by client; which shows their positive approach to energy efficiency and sustainability.

Our Observations & Recommendations are summarized as below-

Energy saving and sustainability improvement measures undertaken by college management are as follows.


1. Replacement of fluorescent lights with energy efficient LED lights.
2. Selection of Energy Efficient Equipment's (BEE 5 Star Labeled) whenever replacement of any equipment is to be done.
3. Active Harmonic Filter is also installed to control Harmonics.
4. Maintaining energy consumption records of each section to track energy consumption of the premise.
5. Use of Solar energy for water heating purpose instead of electric geysers.
6. Use of Solar Photovoltaic system to generate own electricity using rooftop area available at the premise.

Recommendations for further energy savings are as follows-

1. Use of heat pumps wherever possible in college premises for cooling and heating.
2. Use of aerators for water taps.
3. Cost saving measure - Fine tuning of Automatic Power Factor Correction system to improve PF to unity & reduce billing units in kVAh billing system.
4. Cost Saving measure - Reduce contract demand to last recorded highest demand to reduce the excess demand charges being paid each month.

Yours truly,

UPENDRA G. DEUSKAR  
BEE Certified Energy Auditor.  
Regn. No.- EA -1674



Principal  
AISSMS College of Pharmacy  
Pune-1